



ELECTRICAL CONTRACTOR TO PROVIDE

- ALL CONDUIT AS DETAILED
- 20 AMP SERVICE TO TELLER AREA, AS SHOWN
- 117 VAC SERVICE, 30 AMP SERVICE TO EACH CUSTOMER UNIT (20 AMP FULL LOAD)
- CONDUIT 'C' IS FOR LOW VOLTAGE CONTROL CABLES INSTALLED BY TUBE SUPPLIER - ELECTRICAL CONTRACTOR TO PROVIDE PULL WIRES IN EACH CONDUIT

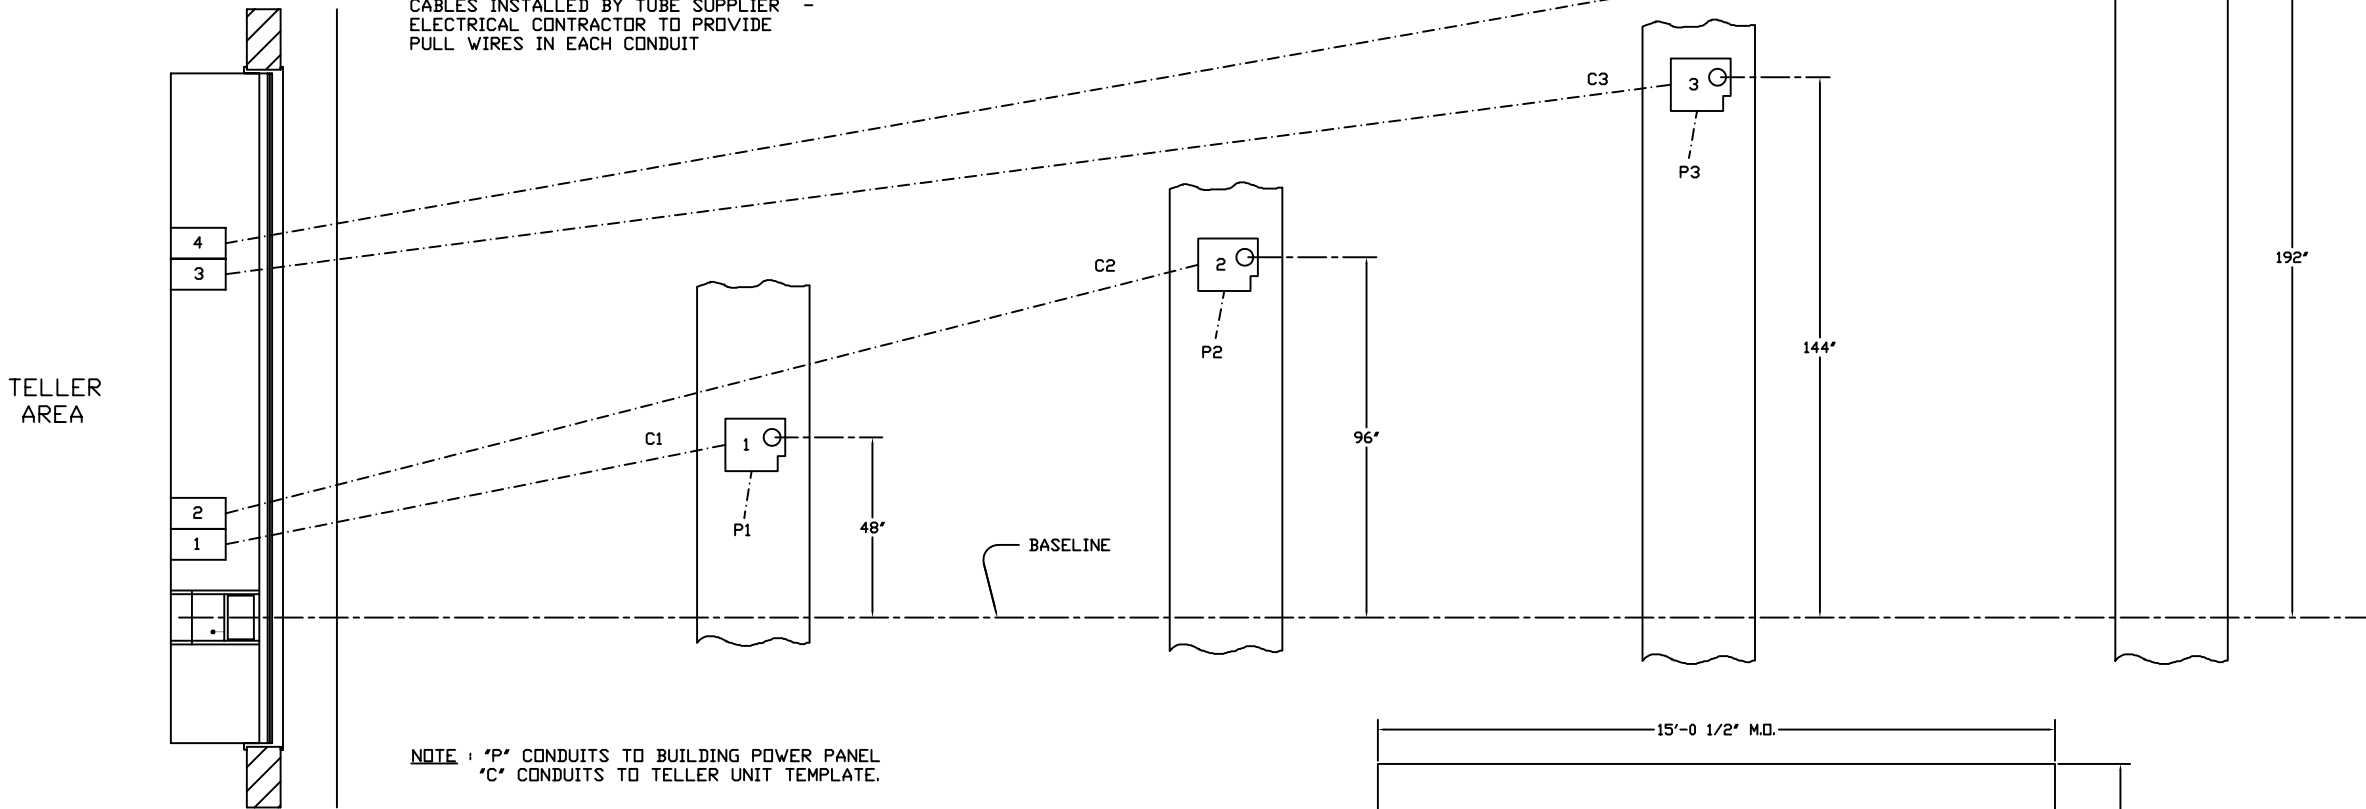


PLAN

NOTE : 'P' CONDUITS TO BUILDING POWER PANEL  
'C' CONDUITS TO TELLER UNIT TEMPLATE.

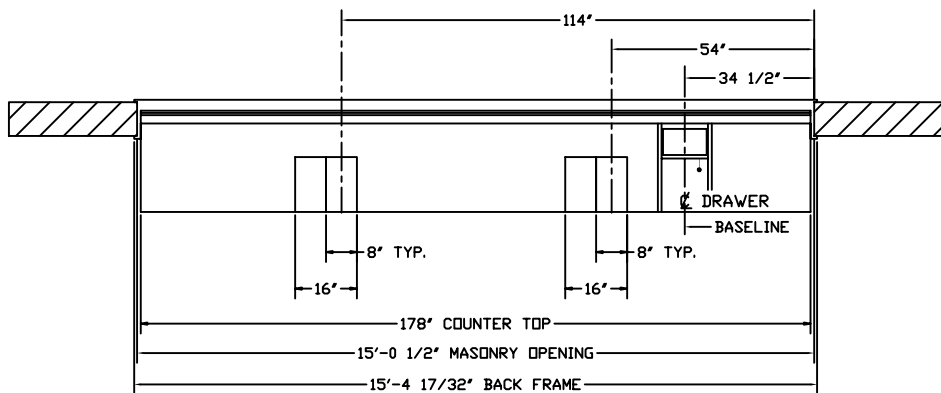

PLAN - INTERIOR

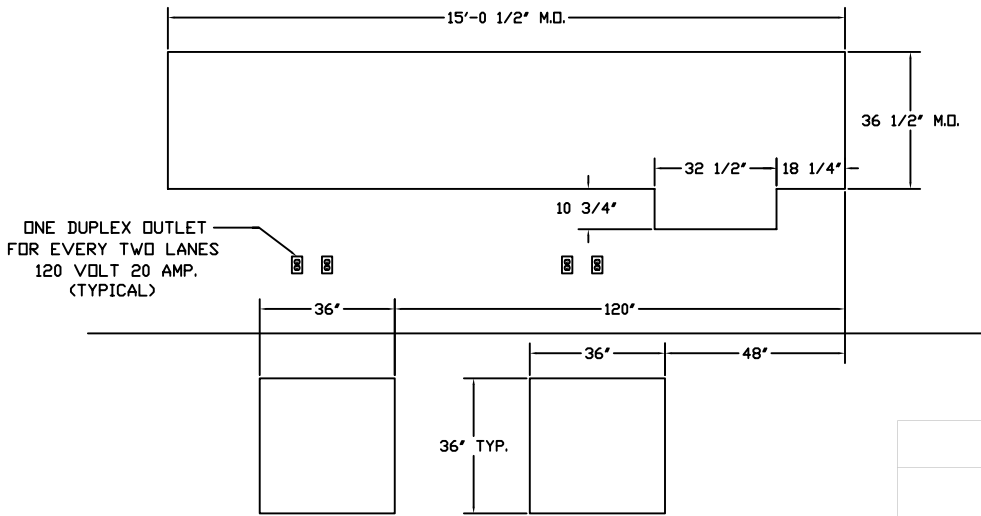

MASONRY DETAIL  
(FOR MODEL 315D U.L. WINDOW)

<b>HAMILTON AIR</b>	
MODEL HA-1000-D 413 SYSTEM - DOWNSEND INTERIOR DETAILS	
Drawing Number : 99-514	Date : 3-29-93